

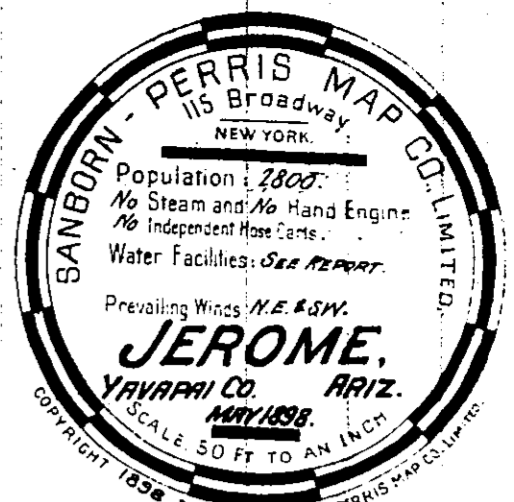
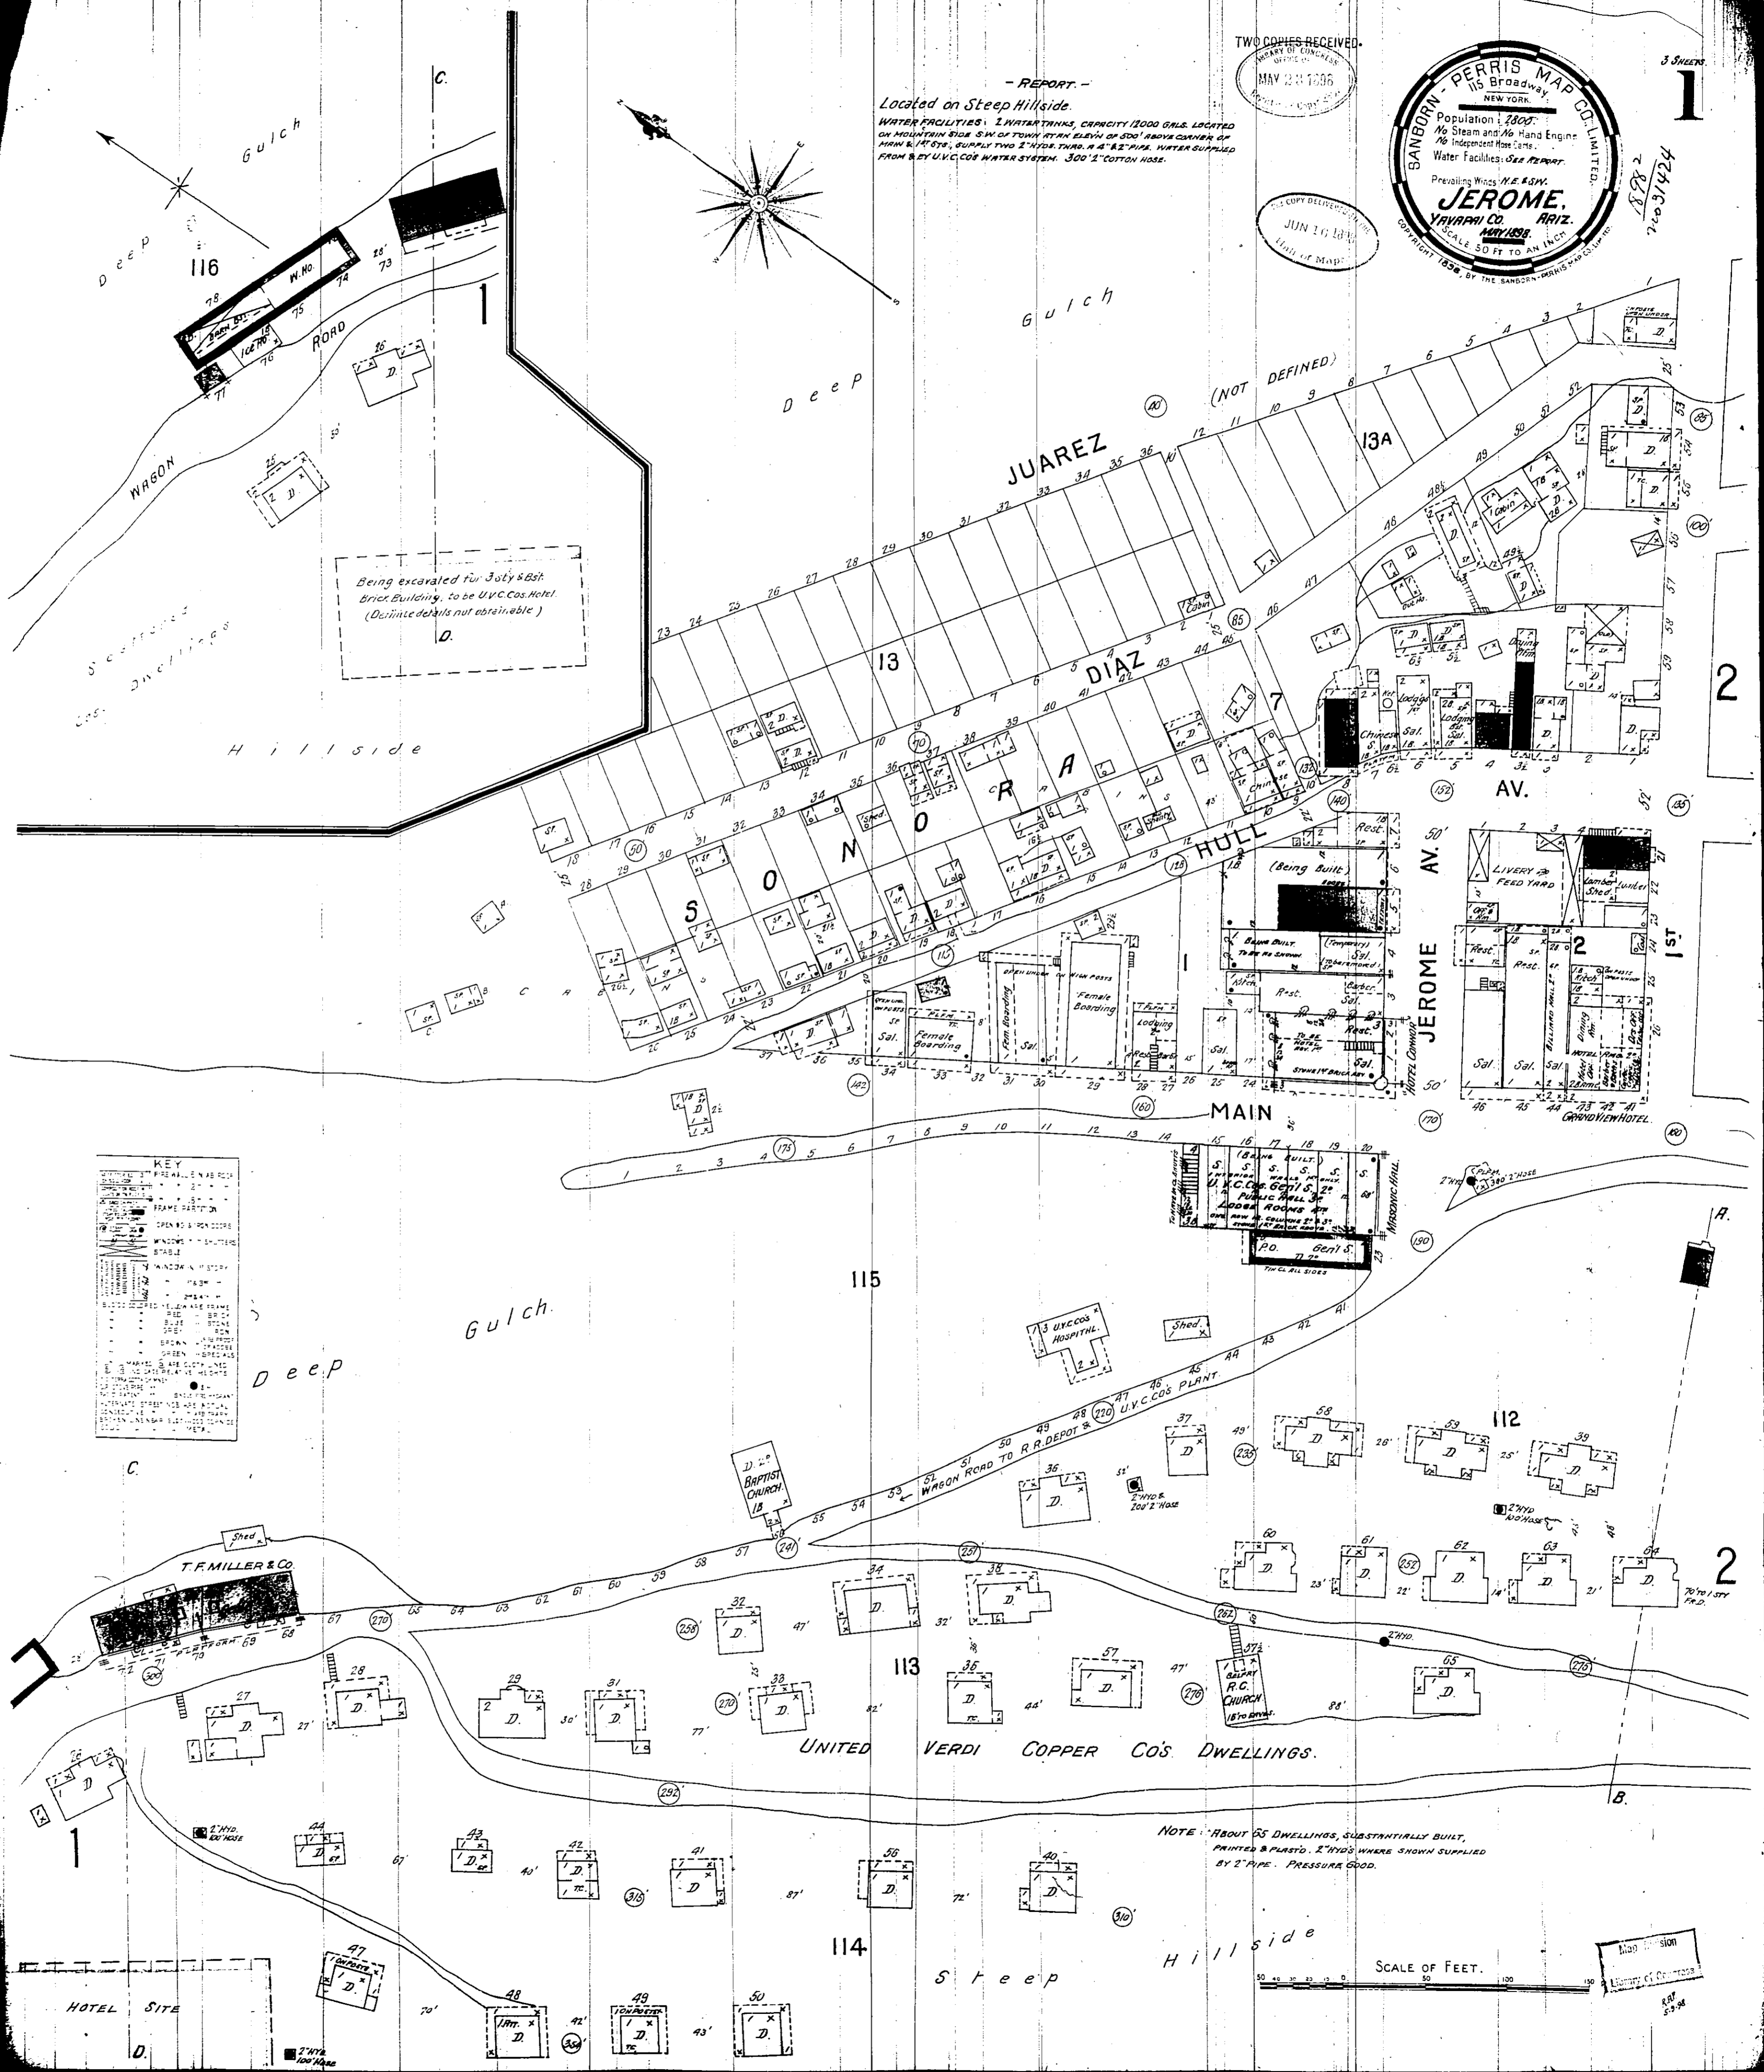


TWO COPIES RECEIVED
MAY 23 1936

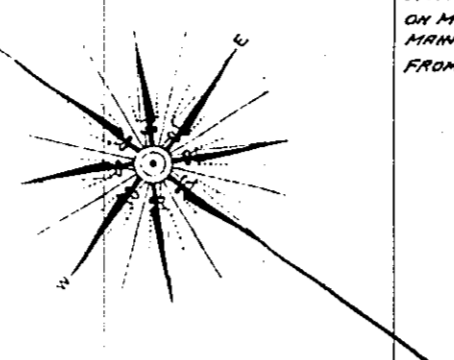

- REPORT -
Located on Steep Hillside.
WATER FACILITIES: 2 WATER TANKS, CAPACITY 1200 GALS. LOCATED ON MOUNTAIN SIDE S.W. OF TOWN AT AN ELEVATION OF 500' ABOVE CORNER OF MAIN R. 14' DIA. SUPPLY TWO 2" HYD. TUBES. A 4" x 2" PIPE. WATER SUPPLIED FROM R.V.C. CO'S WATER SYSTEM. 300' 2" COTTON HOSE.

ONE COPY DELIVERED TO
JUN 10 1936
TOWN OF MADEIRA

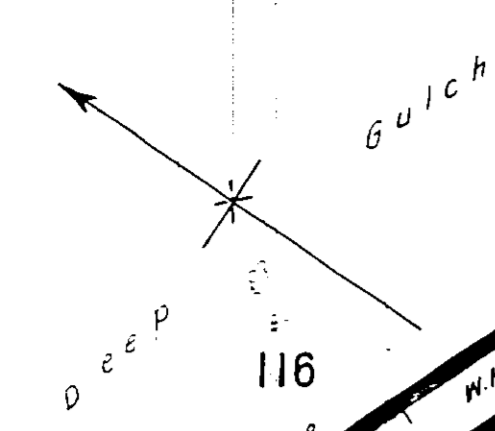


Being excavated for 30x40 ft. Brick Building, to be U.V.C. Co's Hotel. (Definite details not obtainable.)

KEY

PRELIMINARY	...
FRAME PARTITION	...
OPEN END BRICK CORE	...
WINDING HISTORY	...
...	...

NOTE: ABOUT 65 DWELLINGS, SUBSTANTIALLY BUILT, PAINTED & PLASTERED. 2" HYD. WHERE SHOWN SUPPLIED BY 2" PIPE. PRESSURE GOOD.

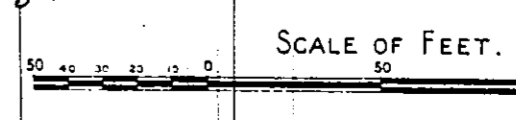

Map Division
MAY 23 1936